
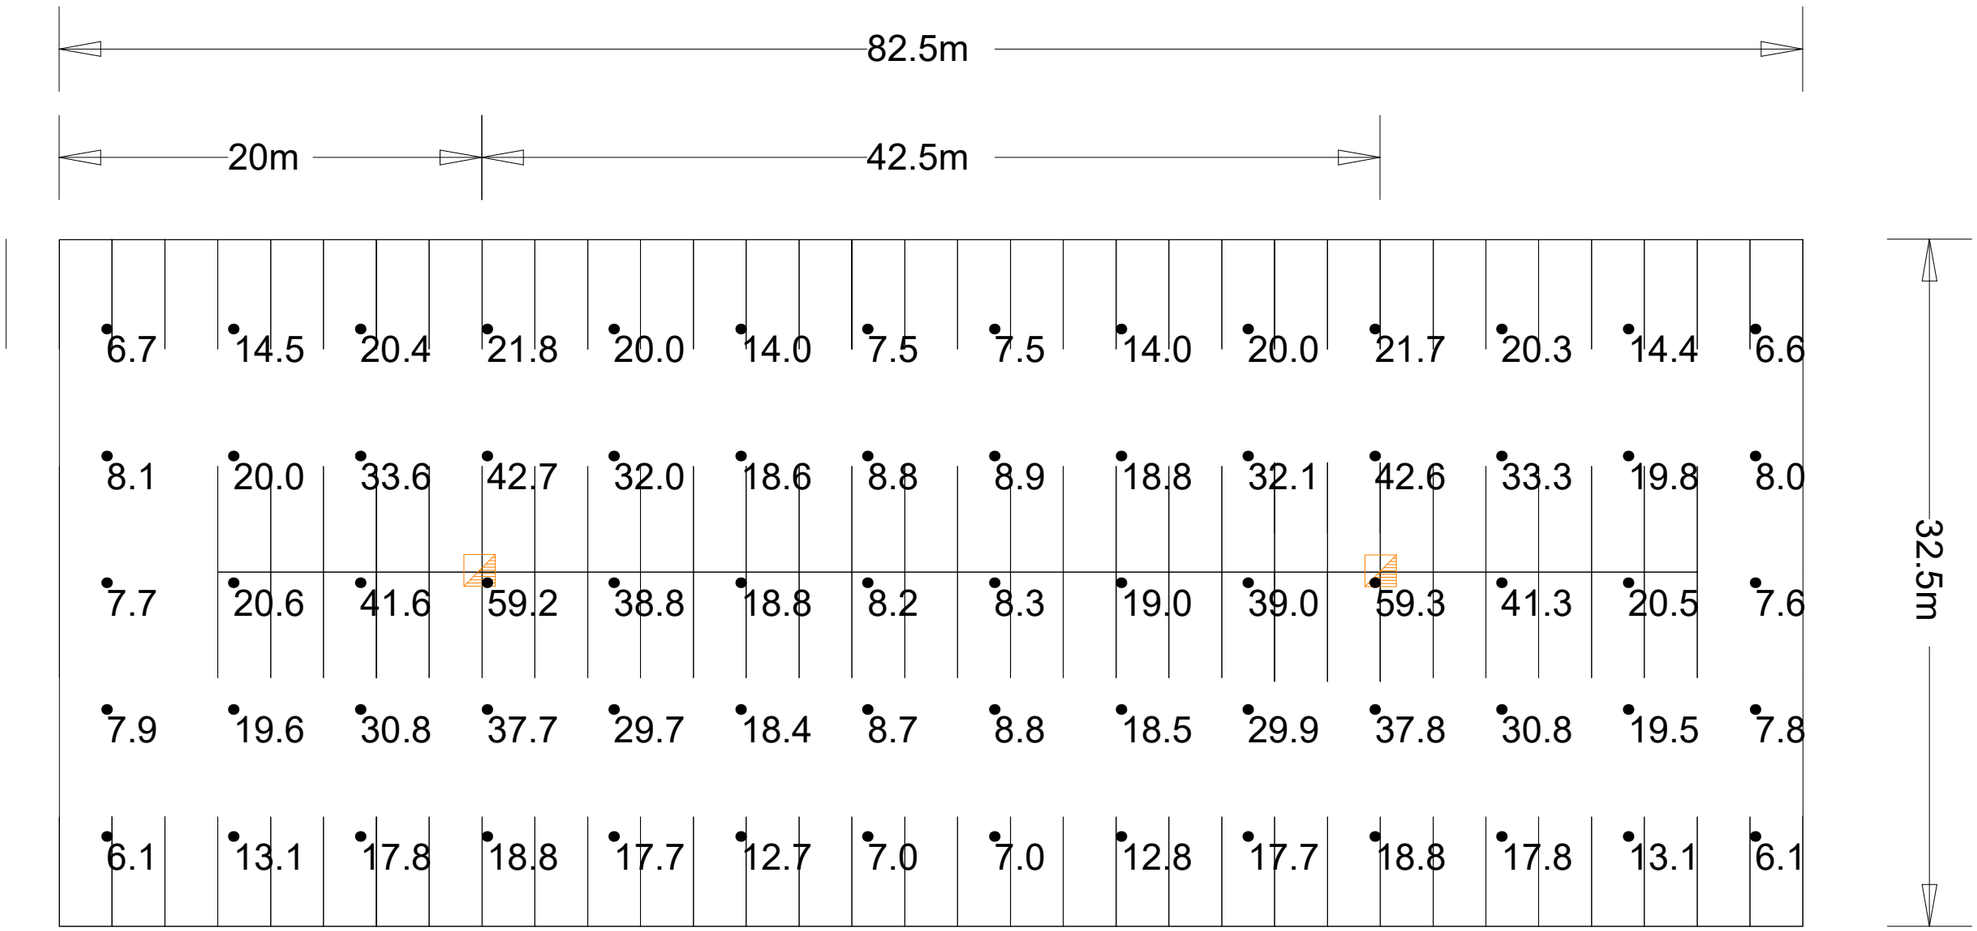


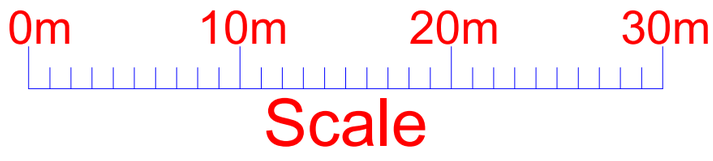

Luminaire Location Summary

		Insertion Point				
LumNo	Label	X	Y	Z	Orient	Tilt
1	S267-S	76.799	62.739	8	0	0
2	S267-S	119.43	62.711	8	0	0
Total Quantity: 2						

Calculation Summary

Description	Avg	Max	Min	Min/Avg	Min/Max	Units	PtSpcLr	PtSpcTb	# Pts
Carpark	20.27	59.3	6.1	0.30	0.10	Lux	6	6	70

NOTE:
Actual results achieved may vary from predicted values due to normal deviation in luminaire installation, electrical supply, equipment tolerances, obstructions including poles, brackets and mounting arms, reflectances etc.

This design is for general guidance only & its use is subject to conditions (available on request).

Based On
Lumen Output at 50000 Hours,
Spot Lamp Replacement,
Normal Environment,
Annual Cleaning Cycle
Ground is Level.

VeeLite

Project:
Carpark
2 x Solo Symmetric, 8m poles
Heavy Traffic

Client:

Project No:	Drawing No:	Drawn By:
XX-XX-XX	XX-XX-XX-XX	DS
Date: 13/03/2025	Scale: As shown	REV NO: A

Carpark Solo SYM 2 x 8m poles - 42.5m.AGI

Luminaire Schedule

Symbol	Qty	Label	Lum Lumens	MF	Description	Filename
	2	S267-S	36030	0.860	Solo Area Light 267w 128 LED 700mA 4000K Symmetric_Area optic	5SOL00270-G4.ies